RESTRICTED

177 T

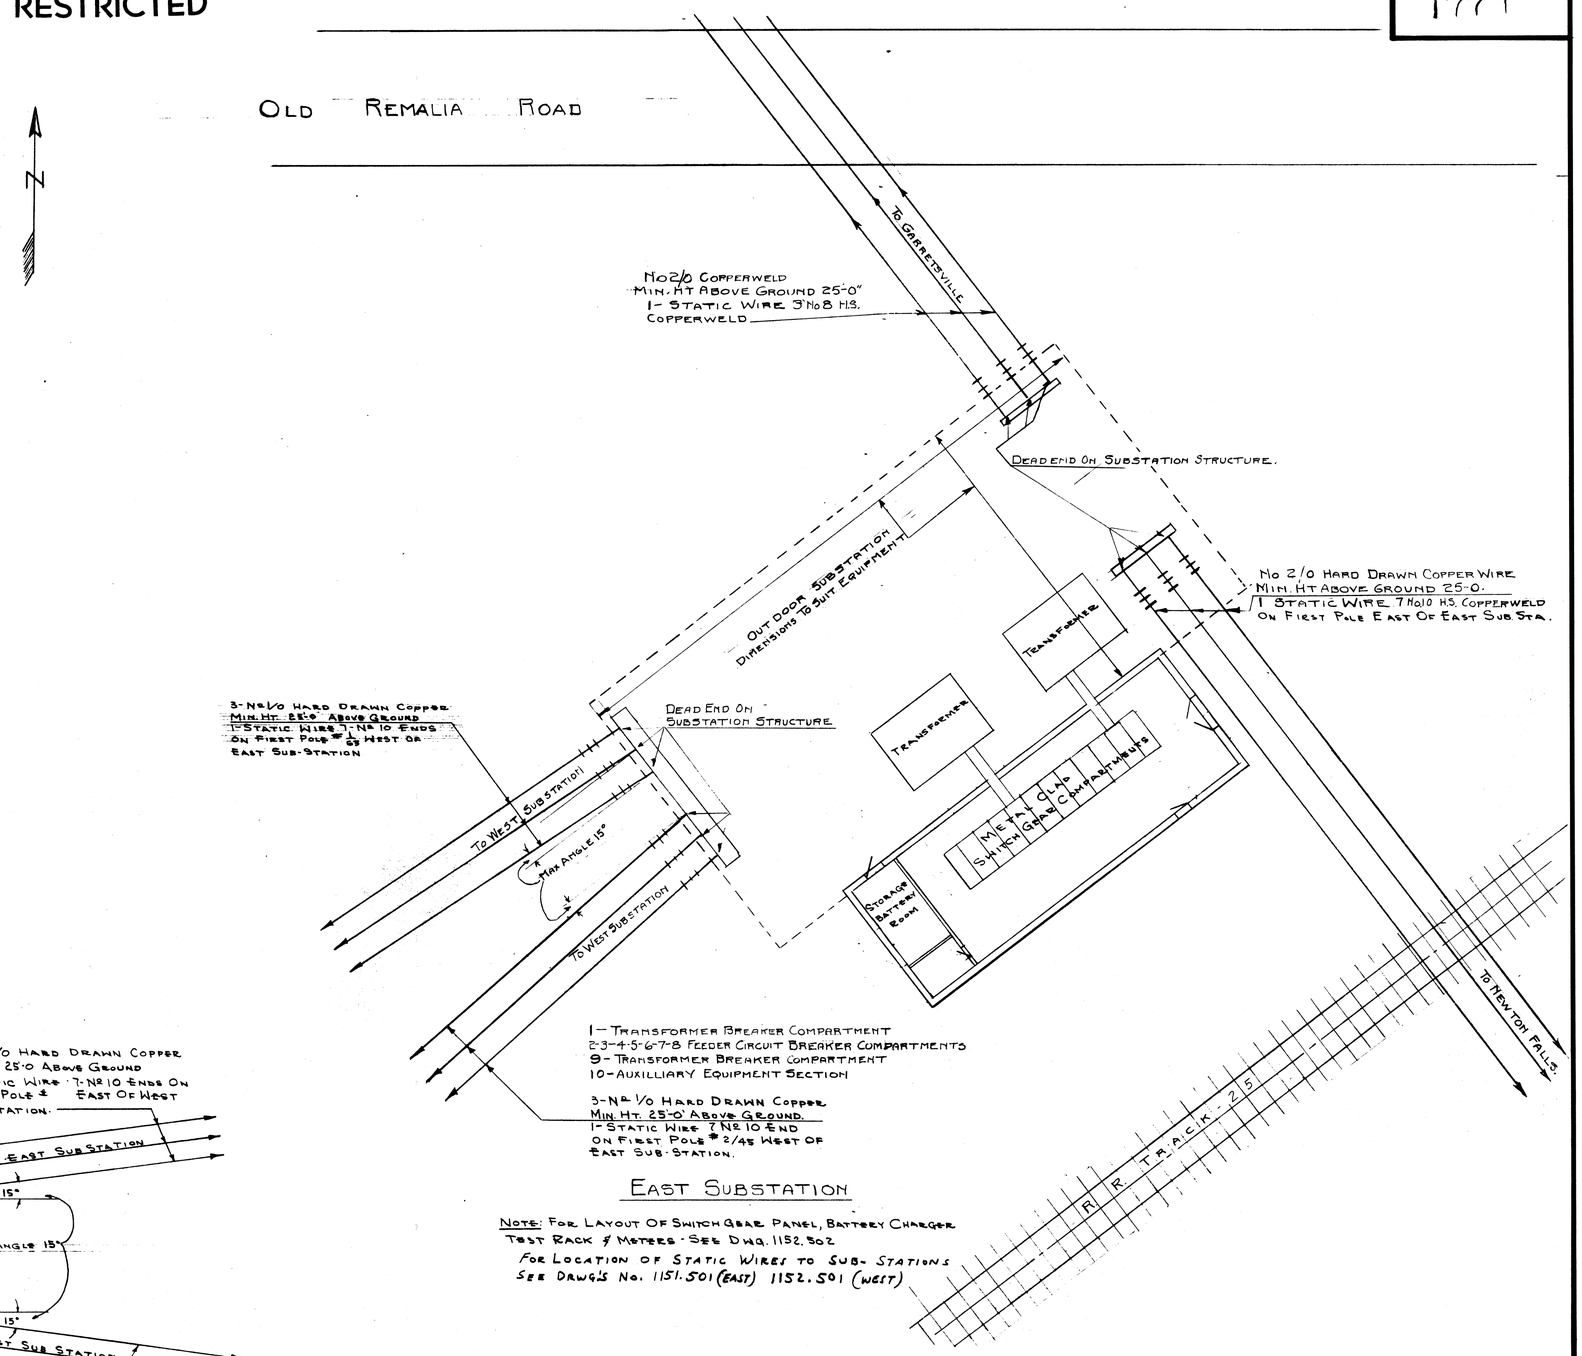

EAST SUBSTATION

NOTE: FOR LAYOUT OF SWITCH GEAR PANEL, BATTERY CHARGER TEST RACK & METERS - SEE DWG. 1152.502
FOR LOCATION OF STATIC WIRES TO SUB-STATIONS SEE DRWGS No. 1151.501 (EAST) 1152.501 (WEST)

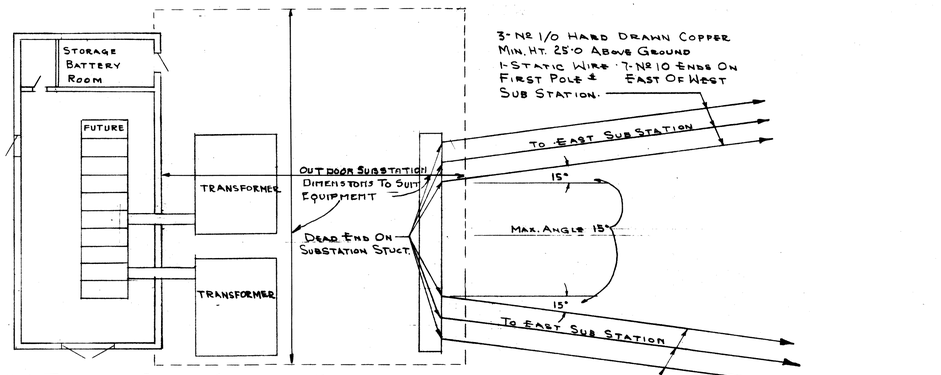

No. 1. TRANSFORMER BREAKER COMPARTMENT
2-3-4-5-6-7 FEEDER CIRCUIT BREAKER COMPARTMENTS
8 TRANSFORMER BREAKER COMPARTMENT
9 AUXILLIARY EQUIPMENT SECTION

NOTE:- FOR LAYOUT OF PANEL, BATTERY CHARGER, TEST RACK & METERS. SEE DWG. 1152.502

WEST SUB STATION.

3-No 1/0 HARD DRAWN COPPER
MIN. HT. 25'-0 ABOVE GROUND
1-STATIC WIRE - 7-No 10 ENDS ON
FIRST POLE # EAST OF WEST
SUB STATION.

RAVENNA ARMY AMMUNITION PLANT RAVENNA, OHIO OPERATED BY RAVENNA ARSENAL, INC.			
APPROVED	SIGNATURE	DATE	TITLE
SAFETY			EAST & WEST SUBSTATION SITE LAYOUT
TECHNICAL MANAGER			
PRODUCTION			
ENGINEERING			
GENERAL MANAGER			
COMMANDING OFFICER			
			REF. DWG NO.
			DRWN. JWO/mee CHKD. ENGR.
			DATE 2-13-70 1150.551
			SCALE NONE

THIS REPRODUCIBLE MADE FROM ORIGINAL PENCIL CONSTRUCTION DRAWING

177 T

RESTRICTED